


Performance Pack


May 2021 (reporting on April 2021)





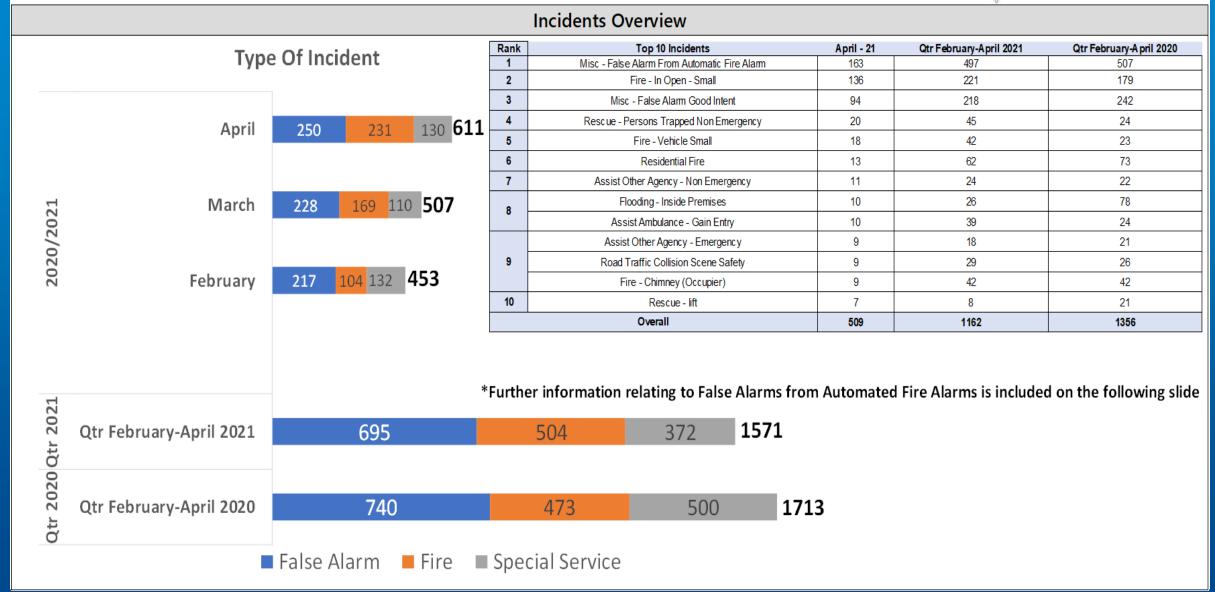


Breakdown Of False Alarms (30/04/2020 - 30/04/2021

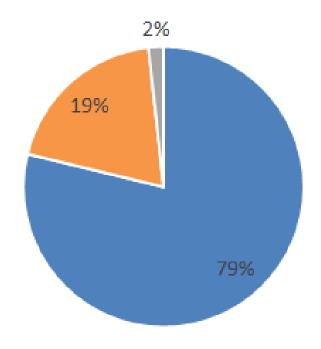

- FAAP False Alarm Apparatus (Auto Fire Detection Systems)
- FAGI False Alarm Good Intent
- FAM False Alarm Malicious


FAAP - False Alarm Apparatus (Auto Fire Detection Systems)






- Residential Premises (Dwelling/Other Residential)
- Non Residential Premises (Non Residential)

FAGI - False Alarm Good Intent



FAM - False Alarm Malicious




- Residential Premises (Dwelling/Other Residential)
- Non Residential Premises (Non Residential)


- Residential Premises (Dwelling/Other Residential)
- Non Residential Premises (Non Residential)





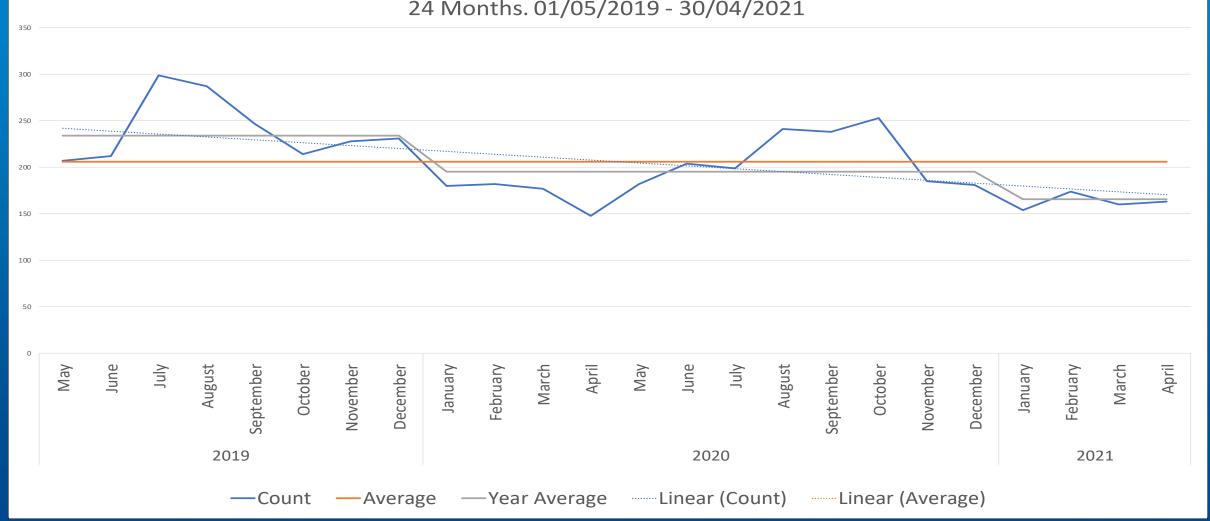



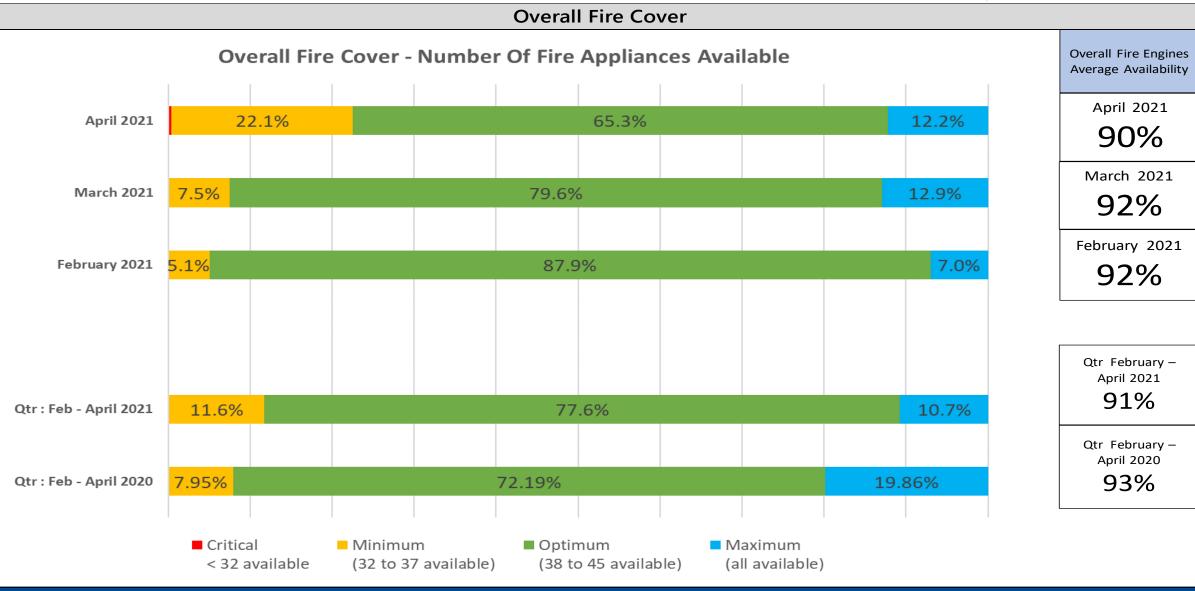



On Call Fire Engines Average Availability

April 2021

85%

March 2021

89%

February 2021


89%


Qtr

Qtr February- April

2021 **88%**

Qtr Qtr February– April 2020 **90%**




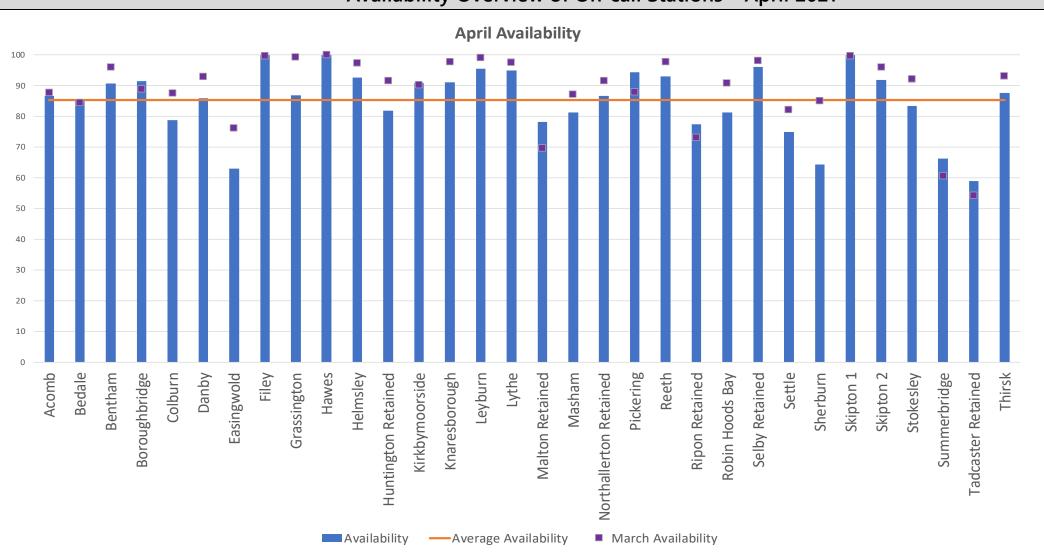


Data Range 30/04/2020 - 30/04/2021



Community Safety - Covid-19 Jobs - All Personnel

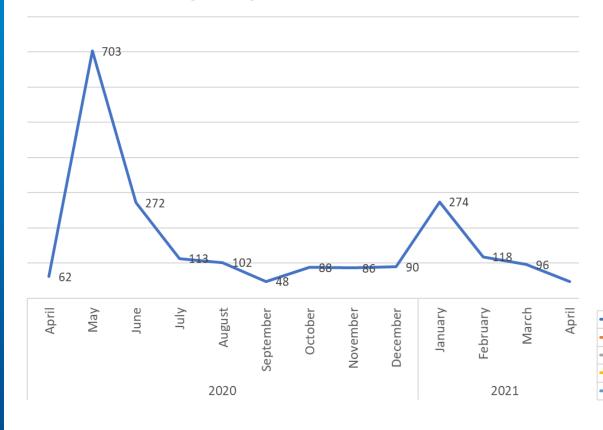


Community Safety - Business As Usual - All Personnel

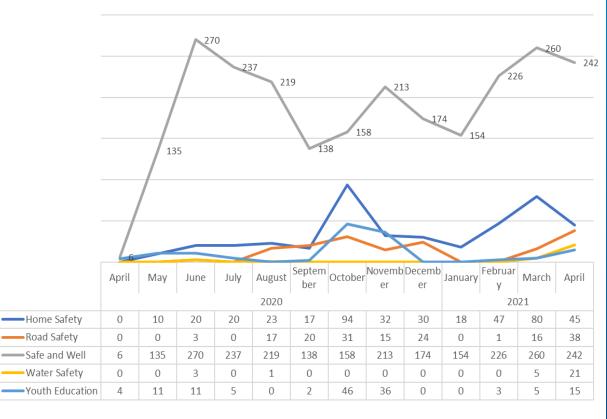



All Statutory & Non Statutory Consultations Business Fire Safety and Operational Station Staff Over 12months

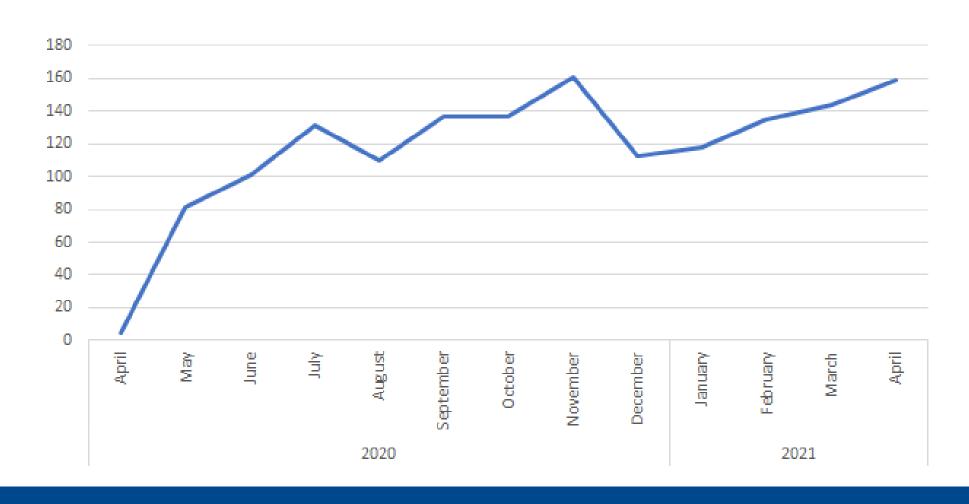



Absence Levels Overview

Data Range 1/04/2020 - 30/04/2021

All sickness absence, Confirmed Cases and COVID - Self Isolation (Including Confirmed Cases) by Date

